

NOTES:

1. A MAX. OF 4 AND A MIN. OF 2 THROAT RINGS SHALL BE USED AT EACH MANHOLE IN NEW OR EXISTING RIGHT-OF-WAY.
2. USE ADEKA SEALANT OR APPROVED EQUAL BETWEEN RING/COVER, ADJUSTMENT RINGS AND CHIMNEY OR CORBEL/CONE SECTION.
3. MANHOLE BASE THICKNESS AND FOUNDATION AS FOLLOWS:

4. MANHOLE LOCATION AND COMPACTION AS FOLLOWS:


LOCATION	COMPACTION REQUIREMENT
PAVEMENT	98 % STANDARD PROCTOR (ASTM D 698)
LANDSCAPE AREA	90 % STANDARD PROCTOR (ASTM D 698)

5. NO RINGS ARE REQUIRED OUTSIDE OF STREET RIGHT-OF-WAY
6. IN FLOODPLAINS OR AREAS OF CONCENTRATED FLOW, THE CONE SHALL EXTEND 1 FOOT ABOVE THE BASE FLOOD ELEVATION OR A BOLT DOWN WATER-TIGHT RING AND COVER SHALL BE USED, VENTED WHERE REQUIRED.
7. WARNING SIGN ONLY TO BE PLACED WHERE SEWER CROSSES OPEN FIELDS.

MANHOLE DEPTH (FT.)	BASE THICKNESS
0 - 12	8"
12 AND OVER	12"

MANHOLE DIA.	MAIN SIZE
4 FT	<18in.
5 FT	≥18in. <30in.
6 FT	≥36in.

NOTE: DEPTHS GREATER THAN 12' WILL REQUIRE 2 MATS OF REINFORCING STEEL IN THE BASE.

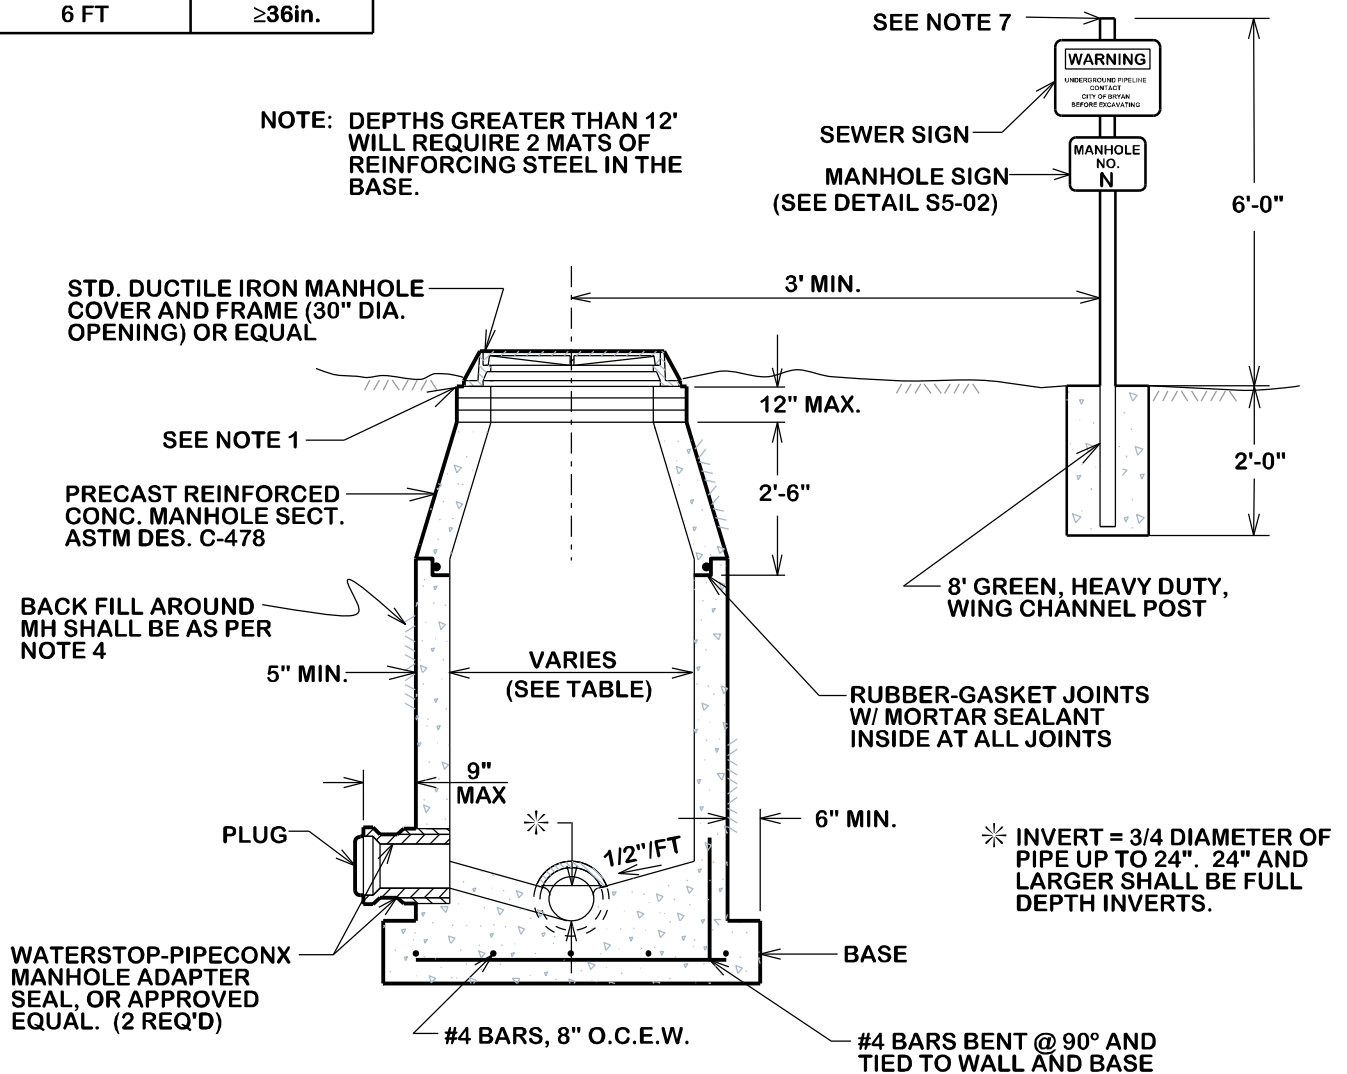

CITY OF BRYAN
The Good Life, Texas Style.

STANDARD PRE-CAST MANHOLE

DATE

AUG. 2012

**B/CS UNIFIED
STANDARD DETAIL**

DETAIL NO.

S1-00A



CITY OF COLLEGE STATION