


NOTES:

1. FOR BEDDING AND TRENCHING WITHIN ALL EXISTING PAVED AREAS, SEE DETAILS FOR OPEN CUT STREETS. (Details ST4-00, ST4-01, ST4-02). THIS NOTE DOES NOT APPLY TO STREETS BEING RECONSTRUCTED.
2. ALL BEDDING & INSTALLATION OF PVC PIPE SHALL BE IN ACCORDANCE TO ANSI/AWWA STANDARDS FOR PVC PIPE.
3. ALL BEDDING & INSTALLATION OF DUCTILE IRON PIPE SHALL BE IN ACCORDANCE TO ANSI/AWWA C150/A21.50.
4. COMPACTION SHALL BE ATTAINED BY MECHANICAL TAMPING.
5. ALL TRENCHES SHALL BE BACK FILLED AND TEMPORARY PAVING OR PLANKING PLACED AT THE END OF EACH WORKING DAY.
6. EVERY 100 FEET PROVIDE A WATER STOP BLOCK COMPOSED OF CEMENT SAND OR IMPERVIOUS NATIVE MATERIAL DEPENDING ON EMBEDMENT. BLOCK SHALL BE 6 FEET IN LENGTH. NO BEDDING SAND IN THIS AREA.

- (A) SELECT NATIVE MATERIAL**
 MATERIAL EXCAVATED FROM THE DITCH, (WHICH IS FREE OF ROCKS, LUMPS, CLODS, OR DEBRIS LARGER THAN TWO (2) INCHES IN THE LARGEST DIMENSION), COMPACTED TO A MINIMUM OF 90% OF MAXIMUM DENSITY AS DETERMINED BY ASTM D698 (STANDARD) AT A MOISTURE CONTENT WITHIN OPTIMUM TO +4% OF OPTIMUM UNDER NON-STRUCTURAL AREAS (ie... YARDS, PASTURES, EASEMENTS) (OPTION 1) AND TO A MINIMUM OF 98% OF MAXIMUM DENSITY AS DETERMINED BY ASTM D698 (STANDARD) AT A MOISTURE CONTENT WITHIN OPTIMUM TO +4% OF OPTIMUM UNDER NEW STREET AREAS AND STREETS TO BE RECONSTRUCTED. (OPTION 2)
- (B) GRANULAR MATERIAL**
 MATERIAL SHALL BE BANK RUN RIVER SAND WHICH IS FREE OF DETRIMENTAL QUANTITIES OF CLAY, DEBRIS, OR ORGANIC MATERIAL AND WHICH, WHEN TESTED BY STANDARD LABORATORY METHODS, MEET THE FOLLOWING REQUIREMENTS:
 MAXIMUM LIQUID LIMIT 45
 MAXIMUM PLASTICITY INDEX 15
 MAXIMUM PERCENT PASSING NO. 200 SIEVE 35
 MINIMUM PERCENT PASSING 3/4" SIEVE 100
 THE MATERIAL SHALL BE FREE FLOWING AND WHEN WET, SHALL NOT ADHERE TO OR FORM A BALL WHEN PRESSED IN HAND.
- (C) CEMENT STABILIZED SAND**
1-1/2" SACKS CEMENT/CY MINIMUM.
2 SACKS CEMENT/CY MINIMUM WHEN DISTANCE BETWEEN SANITARY LINES AND WATER LINES IS < 9FT

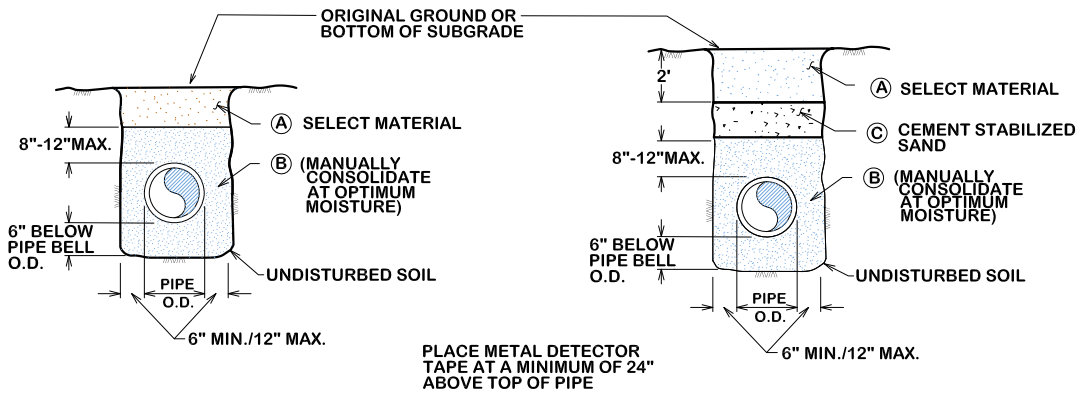

NON-STRUCTURAL AREAS

AREAS TO BE PAVED OR STREETS TO BE RECONSTRUCTED



CITY OF BRYAN
 The Good Life, Texas Style.

BEDDING AND TRENCH FOR DI PIPE & PVC PIPE

DATE

APR 2024

B/CS UNIFIED STANDARD DETAIL

DETAIL NO.

S1-01



CITY OF COLLEGE STATION